


# SKYLIGHT UNDERLAYMENT DETAIL

MC-16

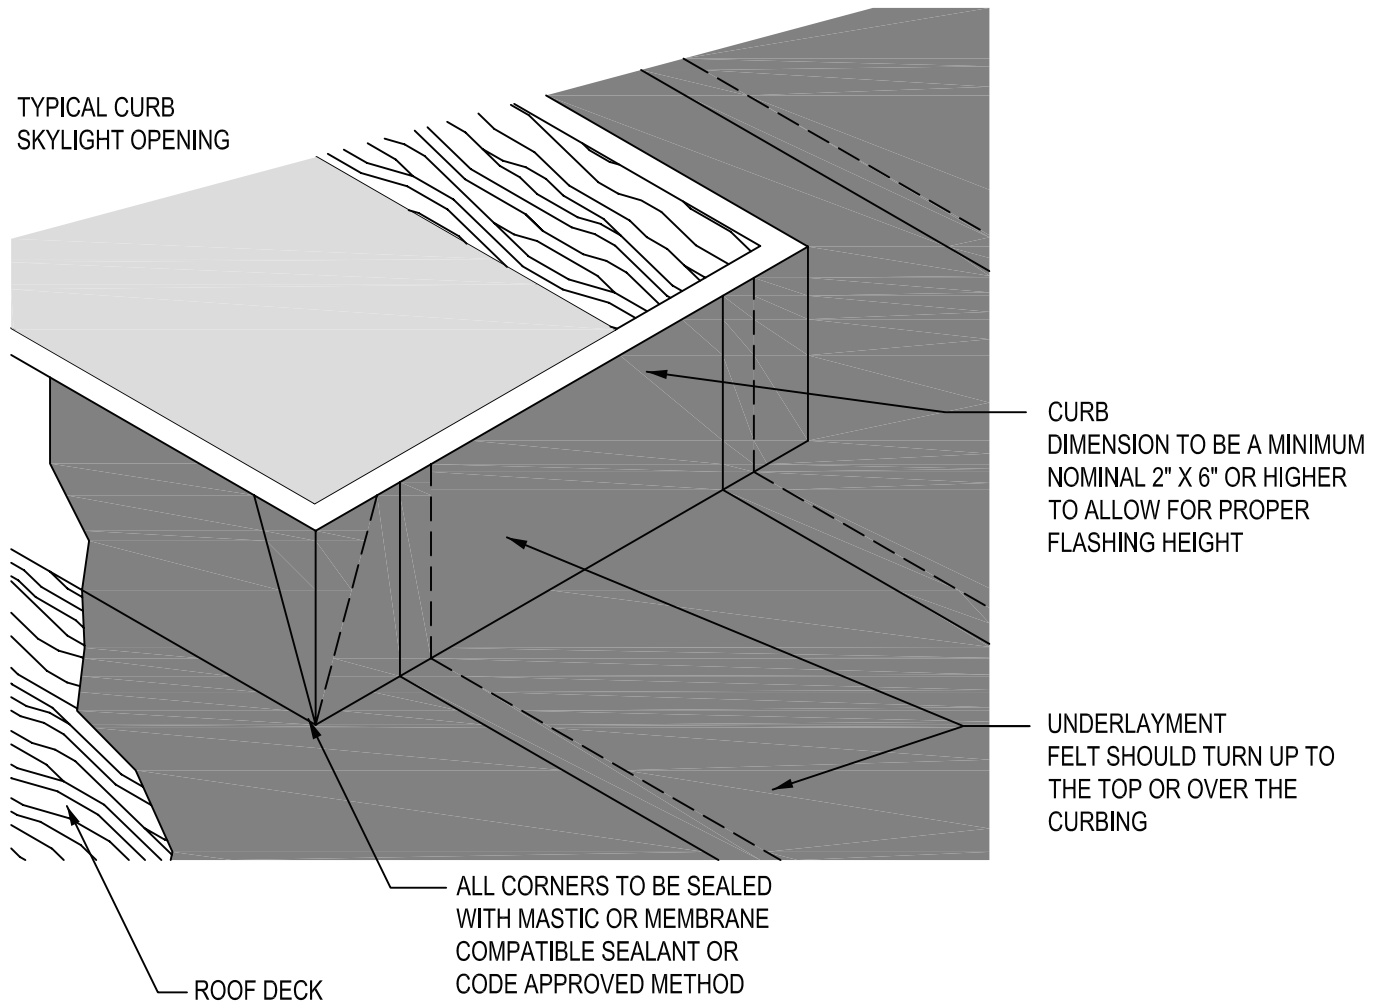

## Notes:

1. One layer of No. 30 asphalt-saturated felt complying with ASTM D-226 Type II (ASTM D4869 TypeIV), or approved equal is required as minimum underlayment on all tile roof applications. Other underlayments as approved by local building officials will be allowed.
2. Dimensions shown are minimums and are intended to be approximate to allow for reasonable tolerances due to field conditions.

DRAWING SHOWN DEPICTS THE APPLICATION OF ALL TILE PROFILES. UNLESS OTHERWISE NOTED IT WOULD APPLY TO EITHER CONCRETE OR CLAY TILES.

Copyright© Tile Roofing Institute/WSRCA  
ICC-ES ESR-2015 01/2002, revised 04/2006

*USA Owned. USA Made.*

[www.eagleroofing.com](http://www.eagleroofing.com)

