
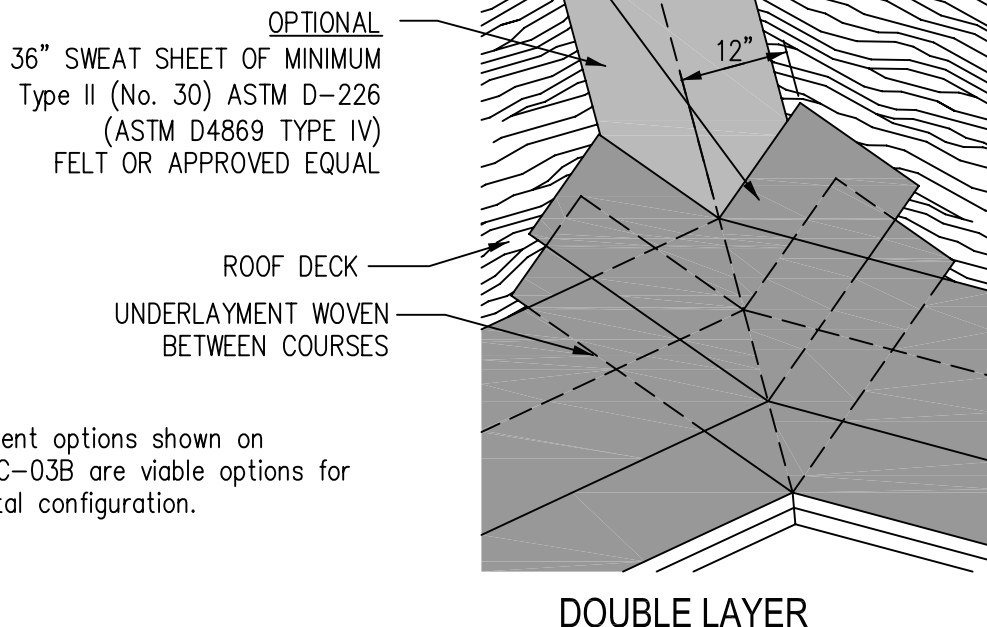


VALLEY UNDERLAYMENTS

WOVEN UNDERLAYMENT (Metal Flashing Not Shown)

MC-03

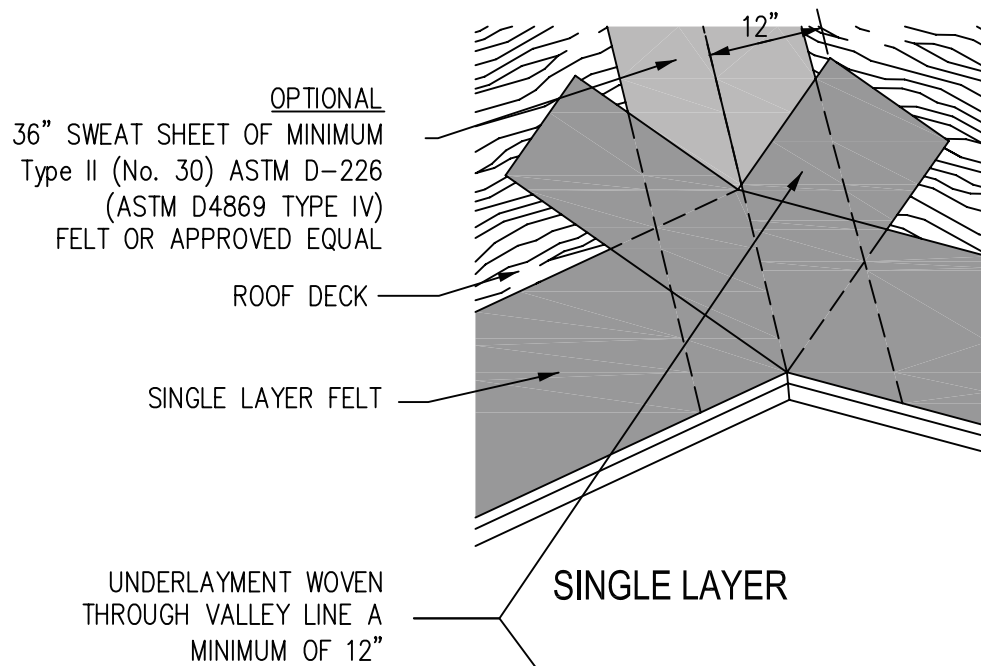

Note:
The underlayment options shown on MC-03A or MC-03B are viable options for any valley metal configuration.

- Notes:
1. One layer of Type II (No. 30) asphalt-saturated felt complying with ASTM D-226 Type II (ASTM D4869 Type IV) or approved equal is required as minimum underlayment on all tile roof applications. Other underlayments may be used as approved by local building officials.

DRAWING SHOWN DEPICTS THE APPLICATION OF ALL TILE PROFILES. UNLESS OTHERWISE NOTED IT WOULD APPLY TO EITHER CONCRETE OR CLAY TILES.

Copyright© Tile Roofing Institute/WSRCA
ICC-ES ESR-2015 01/2002, revised 04/2006

USA Owned. USA Made.
www.eagleroofting.com

