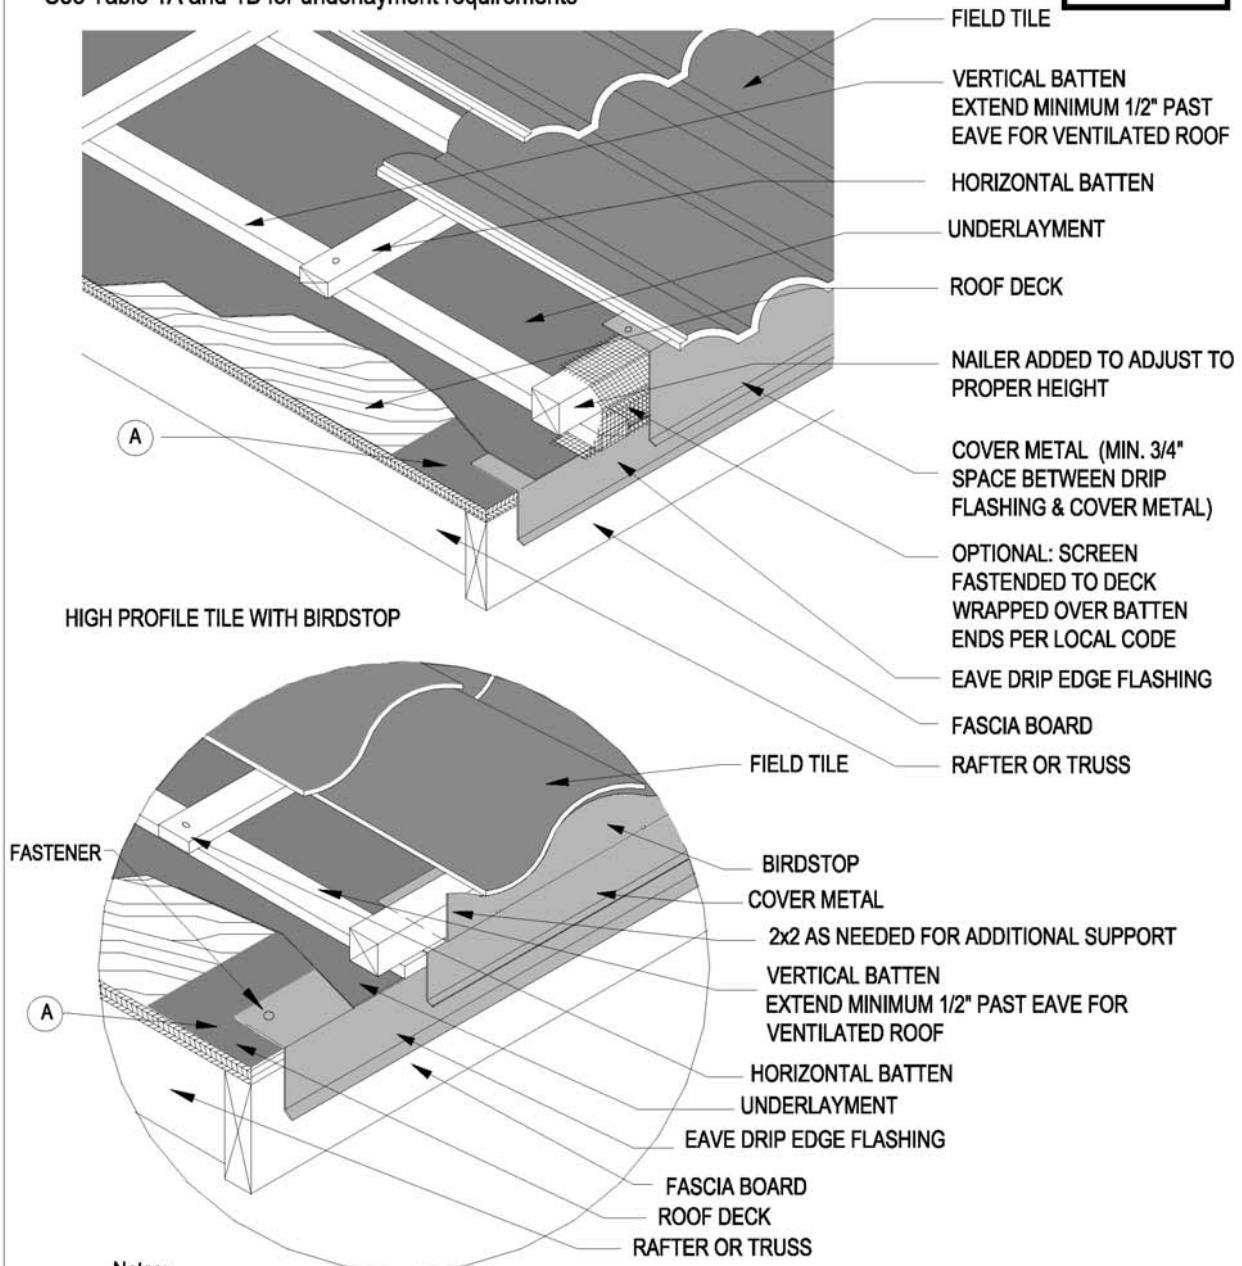


LOW SLOPE / VENTILATED ROOF EAVE DETAIL

MC-10C

See Table 1A and 1B for underlayment requirements


Notes:

1. For recommended underlayment and fastening requirement, see Table 1A and 1B.
 2. A eave drip edge flashing is required at all downs slope perimeter edges.
 3. Eave closure shall be of height equal to combined thickness of batten system and thickness of one course of tile.
Dimensions shown are minimums and are intended to be approximate to allow for reasonable tolerances due to field conditions.
- A. For extended eave optional separator ply or sheet of No.15 asphalt saturated felt or other appropriate material

Drawing shown depicts the application of all tile profiles. Unless otherwise noted it would apply to either concrete or clay tiles.