


RAKE FLASHING - COUNTER BATTEN SYSTEM

(Where Required)

MC-19

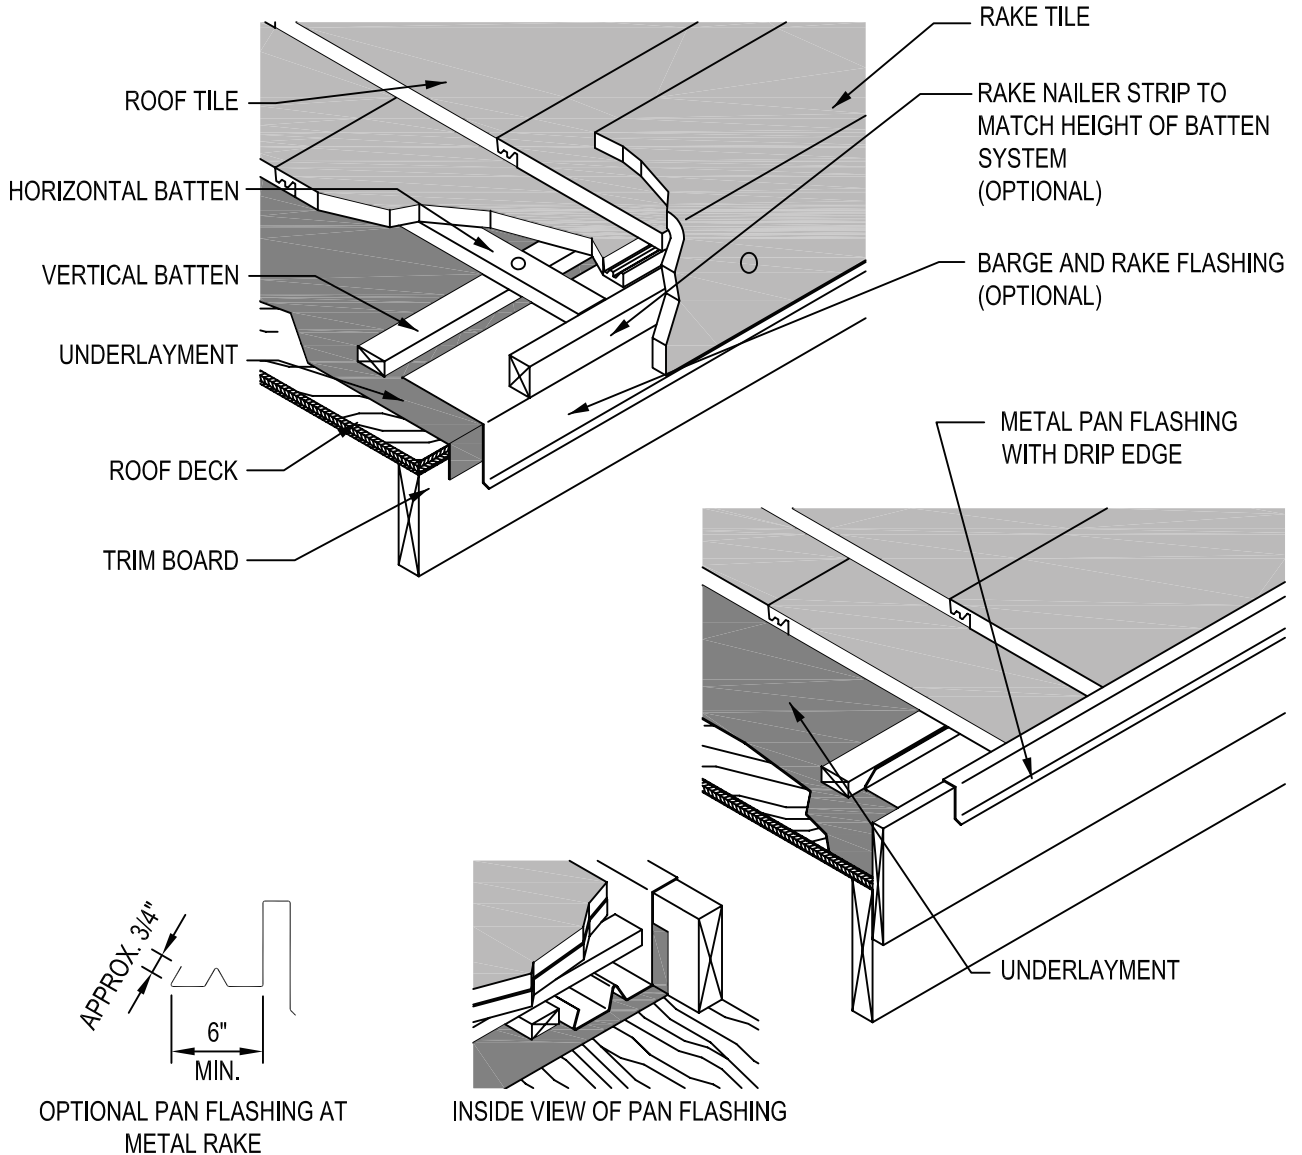

Notes:

1. One layer of No. 30 asphalt-saturated felt complying with ASTM D-226 Type II (ASTM D4869 Type IV) or approved equal as a minimum underlayment on all tile roof applications. Other underlayments as approved by local building officials will be allowed.
2. Sheet metal Flashing shall be a minimum of 26 ga. G-90 galvanized steel, 16 oz. copper or an equivalent longevity non-corrosive metal.
3. For tile fastening schedule see Fastening Table 1A and 1B.
4. Dimensions shown are minimums and are intended to be approximate to allow for reasonable tolerances due to field conditions.
5. Rake flashing and wood nailer/trim board shall be raised above the roof deck to a height greater than the height of the installed roof tile.
6. Rake tiles must be fastened into a minimum nominal 2" gable fascia or equivalent in dimension from multiple pieces.

DRAWING SHOWN DEPICTS THE APPLICATION OF ALL TILE PROFILES. UNLESS OTHERWISE NOTED IT WOULD APPLY TO EITHER CONCRETE OR CLAY TILES.

Copyright© Tile Roofing Institute/WSRCA
ICC-ES ESR-2015 01/2002, revised 04/2006

USA Owned. USA Made.

www.eagleroofing.com

