


SPECIALTY CONDITIONS - PRE-ENGINEERED DECK

MC-26

Installation on Concrete Deck Considerations

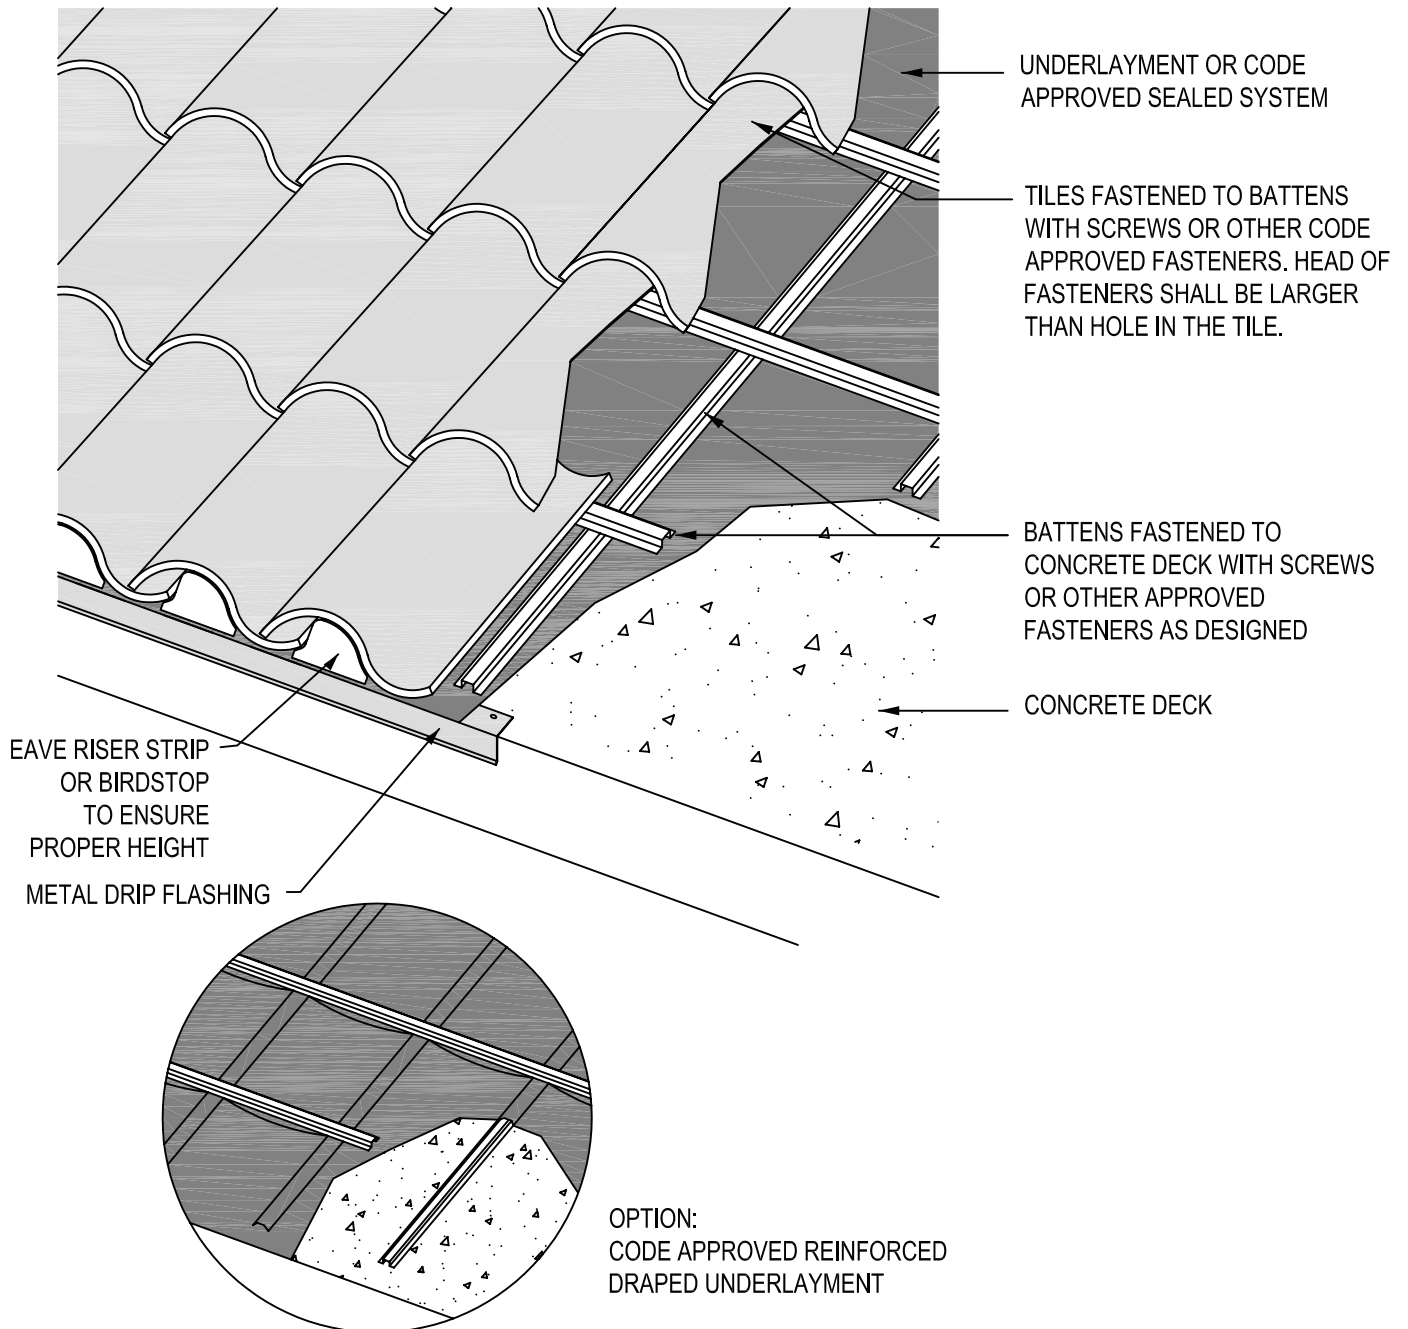

Notes:

1. Vertical battens to be wood or metal as approved or designed as per metal deck manufacturer.
2. Battens attached directly to the deck shall be no longer than 48" and be separated with 1/2" minimum gaps at ends to allow drainage. An alternate method permits use of longer batten strips with shims of 1/4" thick decay-resistant material (e.g. asphalt shingle, wood strips or cap sheet) at each fastener to provide drainage.
3. Dimensions shown are minimums and are intended to be approximate to allow for reasonable tolerances due to field conditions.

DRAWING SHOWN DEPICTS THE APPLICATION OF ALL TILE PROFILES. UNLESS OTHERWISE NOTED IT WOULD APPLY TO EITHER CONCRETE OR CLAY TILES.

Copyright© Tile Roofing Institute/WSRCA
ICC-ES ESR-2015 01/2002, revised 04/2006

USA Owned. USA Made.

www.eagleroofing.com

